



scara 1:50




Sant betonat
scara 1:25

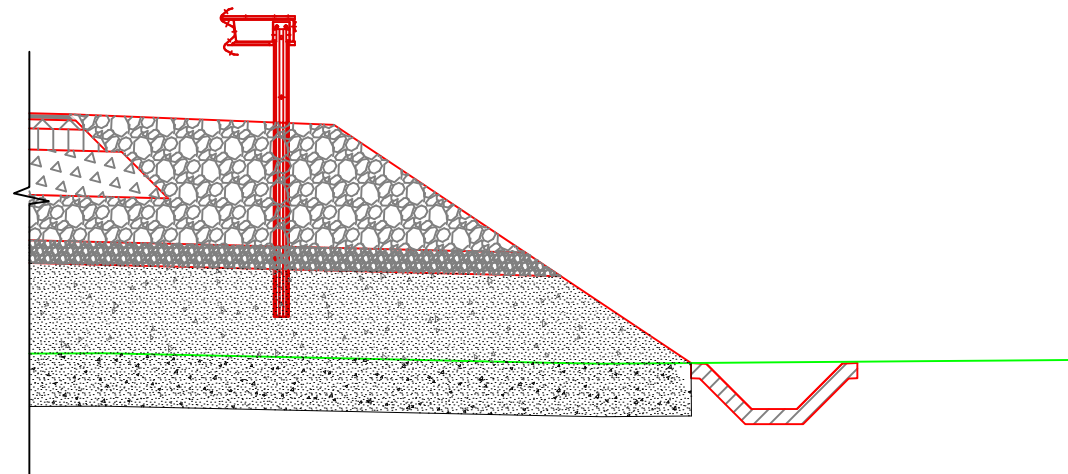

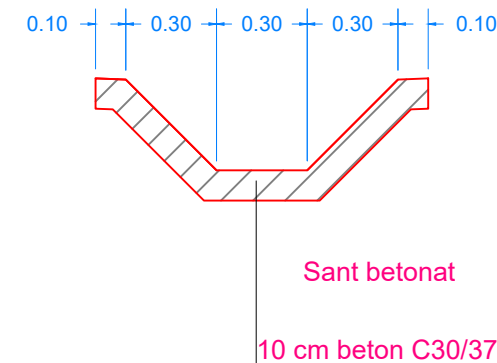


Domenii de aplicare VOTS

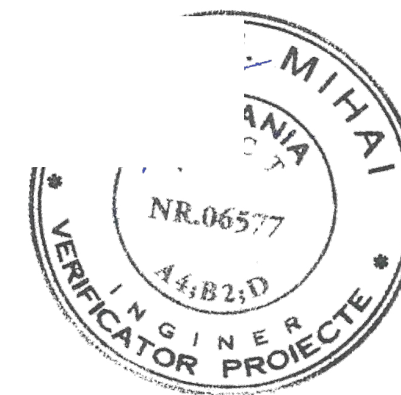STANGA			
Km	Km		
19+450	20+180		



Caracteristicile betoanelor utilizate pentru
dispozitive de scurgere ape:
Referinta la normativul NE 012-1:2007/standardul SR EN 206-1

- Clasa de rezistenta la compresiune	C30/37
- Clasele de expunere (min)	XF4
- Dozaj minim de ciment (min)	340 kg/mc
- Tip ciment conf. SR EN 197-1:2002	CEM I; SRI; I-A 52.5, 42.5; CEM II: A/B-S, IIIA-S, A-LL;
- Raport apa/ciment (max)	0.5

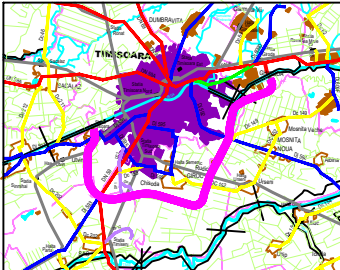INVESTITOR	PROIECTANT GENERAL	AMPLASAMENT	DENUMIRE PROIECT PROIECTARE SI EXECUTIE "VARIANTA DE OCOLIRE TIMISOARA SUD" ELABORARE PROIECT TEHNIC REST DE EXECUTAT	FAZA PROIECT PROIECT TEHNIC REST DE EXECUTAT	Manager de Proiect ing. Silvan Moldovan Sef Echipa Proiectare ing. Raul Cocis Inginer Proiectant Poduri ing. Attila Takacs Inginer Proiectant Drumuri ing. Valentin Oaida	REVIZII			DENUMIRE PLANSA DETALIU SANT TIP 6
						NR. REV.	DATA	SEMN.	
 COMPANIA NATIONALA DE ADMINISTRARE A INFRASTRUCTURII RUTIERE S.A.	 D.P. CONSULT S.A.		NUMAR CONTRACT: 550/36/09.02.2023 NUMAR PROIECT : 556	Data : 03.2023 VERIFICATOR TEHNIC					Scara : 1:50/1:25
									NUMAR PLANSA
									556-VOTM-DET-11